


Notes:

1. This detail applies for service stop boxes in driveway and paved parking areas
2. This detail applies for both PCC or HMA pavements
3. Match slope of final grade and center service stop box under lid
4. Shut-off valve to be 2-inches below lid
5. Pavement and Compacted Base thickness per plans


A Y McDonald Valve Box 5601
w/SS Operating Rod or Stem
Minimum Length 42-inches

Installation Limits:

D. 3' Minimum to 5'
Maximum

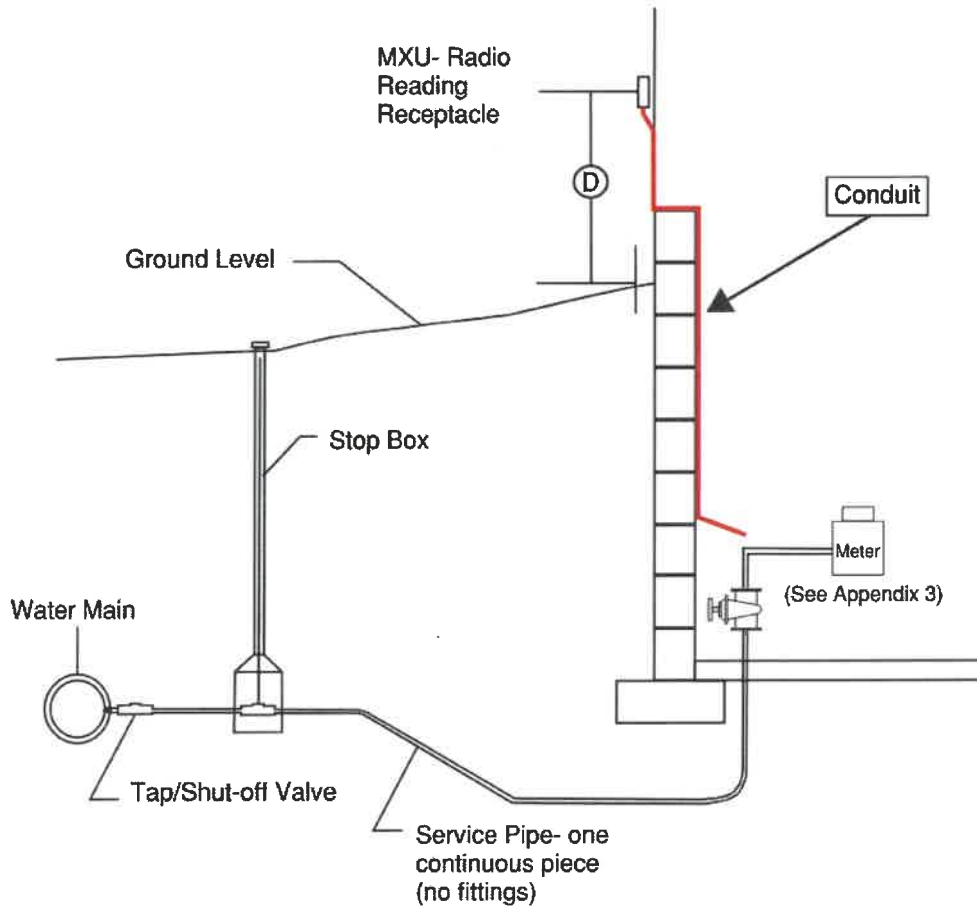

- A. 9" Maximum
- B. 24" Maximum
- C. 36" Maximum
- D. 9" Minimum
- E. 30" Clear Zone

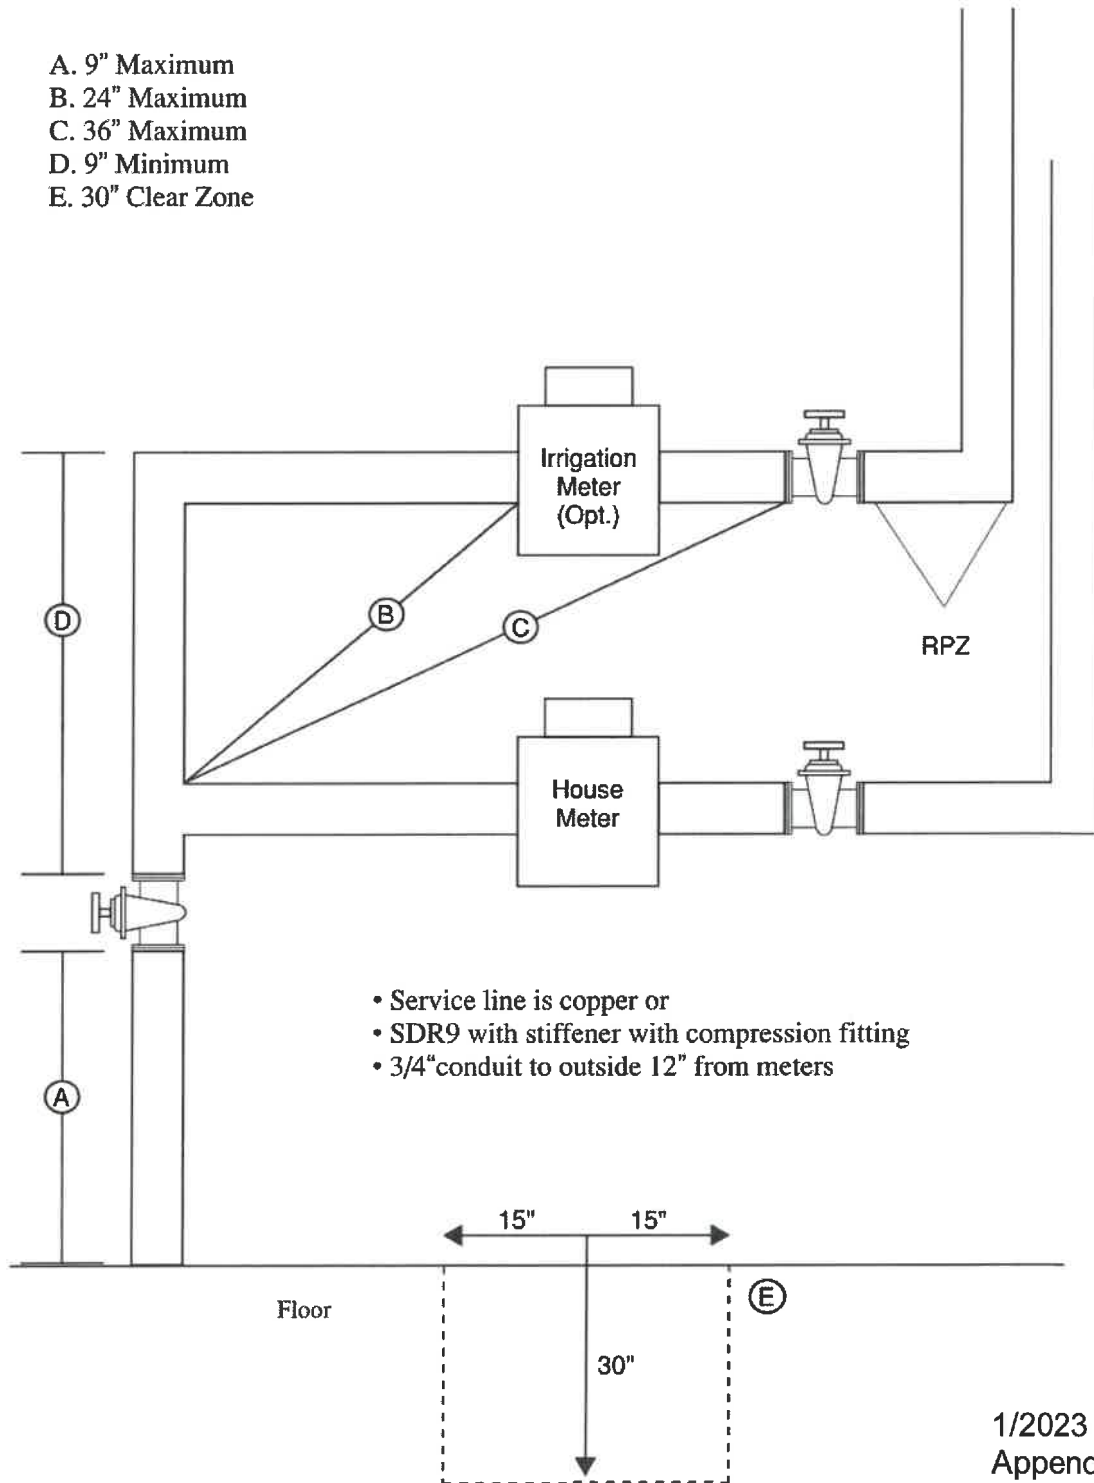

- Service line is copper or
- SDR9 with stiffener with compression fitting
- 3/4" conduit to outside 12" from meters